



NOTES:


1. CONCRETE STRENGTH
25 MPa MIN. @ 28 DAYS.
2. 10M WELDED REBAR
CAGE BODY.
3. GASKET CONSEAL CS-120
7. VOLUME
235 IMP. GAL / 1068 LITRES
8. 3000 LBS / 1360 KGS
9. MAX. FLOW RATE
105 LITRES/MIN.
10. RETENTION TIME - 10 MIN.
11. OPERATING TEMP. RANGE
40-80F / 4-27C
12. SPECIFIC GRAVITY
OIL - 0.71 - 0.92
FRESH WATER - 1.00 - 1.03
13. INTERCEPTOR IS H2O RATED.

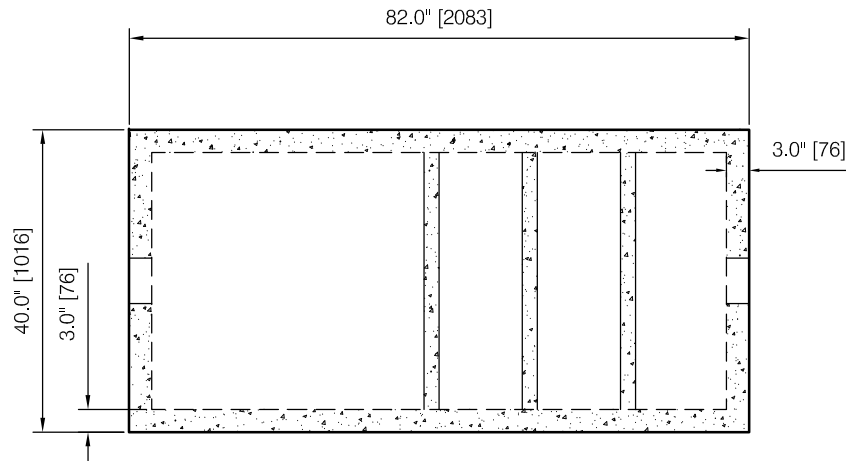


PLAN VIEW

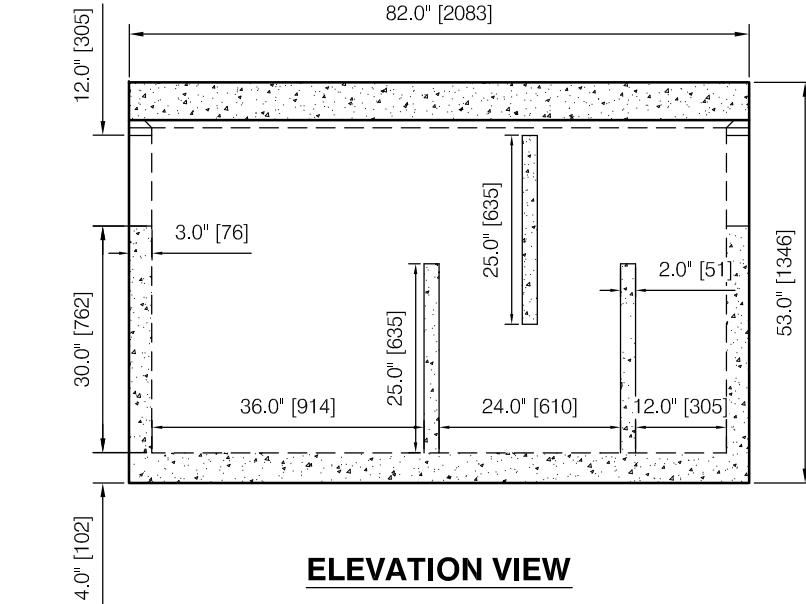


ELEVATION VIEW

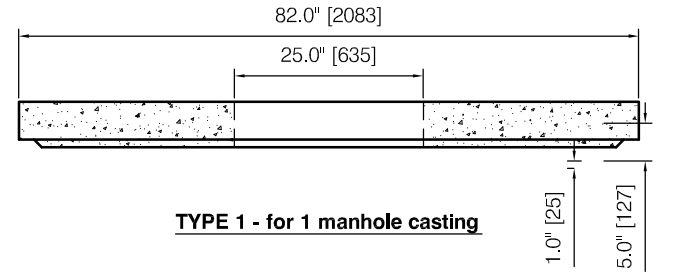

TYPE 1 - for 1 manhole casting

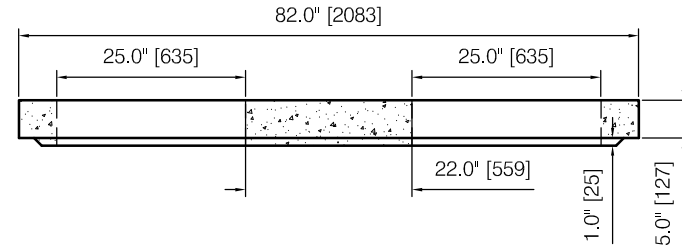

TYPE 2 - for 2 manhole casting

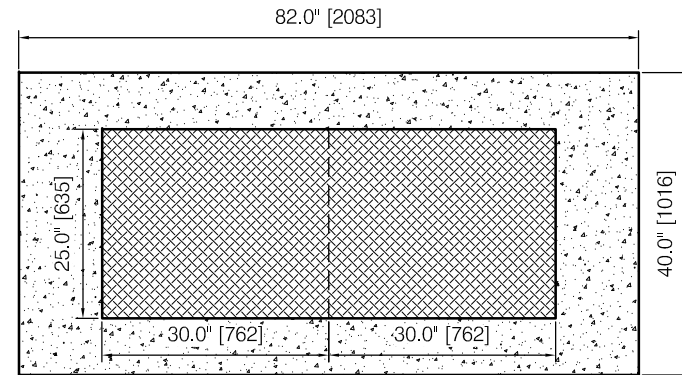

TYPE 3 - for H2O checkered plate lid



A Subsidiary of Northern Vac Services Ltd.
P.O. Box 6868
Fort St. John, B.C., V1J-4J3
Phone: (250) 785-3382
Fax: (250) 785-3381
Email: nvac@shaw.ca

Project:

**250 GALLON (500 LITRES)
OIL INTERCEPTOR**

Drawn:	DVT	Checked by:	CL	Dwg No.	--
Date:	Dec 2015	Cert #	--	Rev:	0



A Division of Northern Vac Services Ltd.
4665 Collier Place
Williams Lake, B.C., V2G-5E0
Phone: (250) 392-3169
Fax: (250) 392-3176
Web: www.grosso-precast.com